



Standard Guide for Underground Installation of “Fiberglass” (Glass- FiberReinforced Thermosetting-Resin) Pipe¹

This standard is issued under the fixed designation D 3839; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the Department of Defense.

^{€1} NOTE—Table 3 was editorially revised in November 2003.

1. Scope

1.1 This practice establishes procedures for the burial of pressure and nonpressure “fiberglass” (glass-fiber-reinforced thermosetting-resin) pipe in many typically encountered soil conditions. Included are recommendations for trenching, placing pipe, joining pipe, placing and compacting backfill, and monitoring deflection levels. Guidance for installation of fiberglass pipe in subaqueous conditions is not included.

1.2 Product standards for fiberglass pipe encompass a wide range of product variables. Diameters range from 1 in. to 12 ft (25 mm to 3600 mm) and pipe stiffness range from 9 to over 72 psi (60 to 500 kPa) with internal pressure ratings up to several thousand pound-force per square inch. This standard does not purport to consider all of the possible combinations of pipe, soil types, and natural ground conditions that may occur. The recommendations in this practice may need to be modified or expanded to meet the needs of some installation conditions. In particular, fiberglass pipe with diameters of a few inches are generally so stiff that they are frequently installed in accordance with different guidelines. Consult with the pipe manufacturer for guidance on which practices are applicable to these particular pipes.

1.3 The scope of this practice excludes product-performance criteria such as a minimum pipe stiffness, maximum service deflection, or long-term strength. Such parameters may be contained in product standards or design specifications, or both, for fiberglass pipe. It is incumbent upon the specified product manufacturer or project engineer to verify and ensure that the pipe specified for an intended application, when installed in accordance with procedures outlined in this practice, will provide a long-term, satisfactory performance in accordance with criteria established for that application.

NOTE 1—There is no similar or equivalent ISO standard.

¹ This practice is under the jurisdiction of ASTM Committee D20 on Plastics and is the direct responsibility of Subcommittee D20.23 on Reinforced Plastic Piping Systems and Chemical Equipment.

Current edition approved Dec. 10, 2002. Published July 2003. Originally published as D 3839 – 79. Last previous edition D 3839 – 94a.

NOTE 2—A discussion of the importance of deflection and a presentation of a simplified method to approximate field deflections are given in AWWA Manual of Practice M45 Fiberglass Pipe Design.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- D 8 Terminology Relating to Materials for Roads and Pavements²
- D 653 Terminology Relating to Soil, Rock, and Contained Fluids³
- D 698 Test Method for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft (600 kN-m/m))³
- D 883 Terminology Relating to Plastics⁴
- D 1556 Test Method for Density and Unit Weight of Soil in Place by the Sand-Cone Method³
- D 1557 Test Method for Laboratory Compaction Characteristics of Soil Using Modified Effort (56 000 ft-lbf/ft (2 700 kN-m/m))³
- D 2167 Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method³
- D 2216 Test Method for Laboratory Determination of Water (Moisture) Content of Soil and Rock³
- D 2321 Practice for Underground Installation of Flexible Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications⁵
- D 2487 Classification of Soils for Engineering Purposes⁵
- D 2488 Practice for Description of Soils (Visual-Manual Procedure)³

² *Annual Book of ASTM Standards*, Vol 04.03.

³ *Annual Book of ASTM Standards*, Vol 04.08.

⁴ *Annual Book of ASTM Standards*, Vol 08.01.

⁵ *Annual Book of ASTM Standards*, Vol 08.04.

- D 2922 Test Methods for Density of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth)³
- D 3017 Test Method for Moisture Content of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth)³
- D 4253 Test Methods for Maximum Index Density and Unit Weight of Soils Using a Vibratory Table³
- D 4254 Test Method for Minimum Index Density and Unit Weight of Soils and Calculation of Relative Density³
- D 4318 Test Method for Liquid Limit, Plastic Limit, and Plasticity Index of Soils³
- D 4564 Test Method for Density of Soil in Place by the Sleeve Method³
- D 4643 Method for Determination of Water (Moisture) Content of Soil by the Microwave Oven Method³
- D 4914 Test Method for Density of Soil and Rock in Place by the Sand Replacement Method in a Test Pit³
- D 4944 Test Method for Field Determination of Water (Moisture) Content of Soil by the Calcium Carbide Gas Pressure Tester Method⁶
- D 4959 Test Method for Determination of Water (Moisture) Content of Soil by Direct Heating Method⁶
- D 5030 Test Methods for Density and Unit Weight of Soil and Rock in Place by the Water Replacement Method in a Test Pit⁶
- D 5080 Test Method for Rapid Determination of Percent Compaction⁶
- F 412 Terminology Relating to Plastic Piping Systems⁵
- 2.2 *Other Standards:*
- AASHTO LRFD Bridge Design Specifications, 2nd Edition, American Association of State Highway and Transportation Officials⁷
- AAHSTO M145 Classification of Soils and Soil Aggregate Mixtures⁷
- AWWA C 950 American Water Works Association Standard Specification for Fiberglass Pressure Pipe⁸
- AWWA Manual of Practice M45 Fiberglass Pipe Design Manual⁸

3. Terminology

3.1 Definitions:

3.1.1 *General*—Unless otherwise indicated, definitions are in accordance with Terminologies D 8, D 653, D 883, and F 412.

3.2 *Definitions of Terms Specific to This Standard:* Descriptions of Terms Specific to This Standard:

3.2.1 *bedding*—backfill material placed in the bottom of the trench or on the foundation to provide a uniform material on which to lay the pipe.

3.2.2 *deflection*—any change in the inside diameter of the pipe resulting from installation or imposed loads, or both; deflection may be either vertical or horizontal and is usually reported as a percentage of the nominal inside pipe diameter.

3.2.3 *engineer*—the engineer in responsible charge of the work or his duly recognized or authorized representative.

3.2.4 *fiberglass pipe*—a tubular product containing glass-fiber reinforcements embedded in or surrounded by cured thermosetting resin; the composite structure may contain aggregate, granular, or platelet fillers, thixotropic agents, pigments, or dyes; thermoplastic or thermosetting liners or coatings may be included.

3.2.5 *final backfill*—backfill material placed from the top of the initial backfill to the ground surface.

3.2.6 *finer*—soil particles that pass a No. 200 sieve.

3.2.7 *foundation*—in situ soil or, in the case of unsuitable ground conditions compacted backfill material, in the bottom of the trench the supports the bedding and the pipe (see Fig. 1).

3.2.8 *geotextile*—any permeable textile material used with foundation, soil, earth, rock, or any other geotechnical engineering related material, as an integral part of a man-made product, structure, or system.

3.2.9 *haunching*—backfill material placed on top of the bedding and under the springline of the pipe; the term haunching only pertains to soil directly beneath the pipe (see Fig. 1).

3.2.10 *initial backfill*—backfill material placed at the sides of the pipe and up to 6 to 12 in. (150 to 300 mm) over the top of the pipe, including the haunching.

3.2.11 *manufactured aggregates*—aggregates that are products or by-products of a manufacturing process, or natural aggregates that are reduced to their final form by a manufacturing process such as crushing.

3.2.12 *maximum standard Proctor density*—the maximum dry unit weight of soil compacted at optimum moisture content, as obtained by laboratory test in accordance with Test Method D 698.

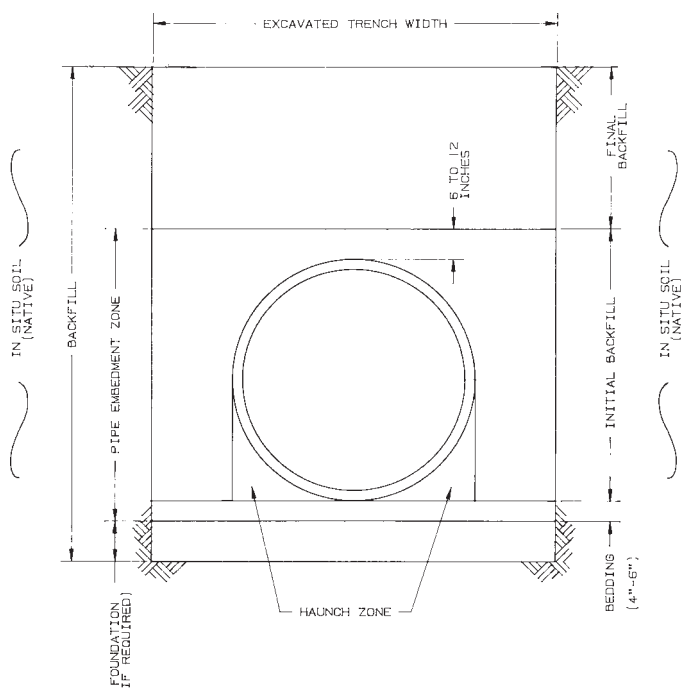


FIG. 1 Trench Cross-Section Terminology

⁶ Annual Book of ASTM Standards, Vol 04.09.

⁷ Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., NW, Suite 249, Washington, DC 20001.

⁸ Available from American Water Works Association (AWWA), 6666 West Quincy Ave., Denver CO 80235.

3.2.13 *native (in situ) soil*—natural soil in which a trench is excavated for pipe installation or on which a pipe and embankment are placed.

3.2.14 *open-graded aggregate*—an aggregate that has a particle-size distribution such that, when compacted, the resulting voids between the aggregate particles, expressed as a percentage of the total space occupied by the material, are relatively large.

3.2.15 *optimum moisture content*—the moisture content of soil at which its maximum density is obtained. (See Test Method D 698.)

3.2.16 *pipe zone embedment*—all backfill around the pipe; this includes the bedding, haunching, and initial backfill.

3.2.17 *processed aggregates*—aggregates which are screened or washed or mixed or blended to produce a specific particle-size distribution.

3.2.18 *relative density*—a measure of the density of a granular soil based on the actual density of the soil “relative” to the soil in its loosest state and the soil in its densest state (see Terminology D 653 for a precise definition) as obtained by laboratory testing in accordance with Test Methods D 4253 and D 4254.

3.2.19 *soil stiffness*—a property of soil, generally represented numerically by a modulus of deformation that indicates the relative amount of deformation that will occur under a given load.

3.2.20 *split installation*—an installation in which the initial backfill consists of two different materials; the first material extends from the top of the bedding to a depth of at least 0.6 times the diameter and the second material extends to the top of the initial backfill.

4. Significance and Use

4.1 This practice is for use by designers and specifiers, manufacturers, installation contractors, regulatory agencies, owners, and inspection organizations involved in the construction of buried fiberglass pipelines. As with any practice, modifications may be required for specific job conditions, or for special local or regional conditions. Recommendations for inclusion of this practice in contract documents for a specific project are given in Appendix X1.

5. Materials

5.1 *Classification*—Soil types used or encountered in burying pipes include those classified in Table 1 and natural, manufactured, and processed aggregates. The soil classifications are grouped into soil-stiffness categories (SC#) in Table 2 based on the typical soil stiffness when compacted. Category SC1 indicates a soil that generally provides the highest soil stiffness at any given percentage of maximum Proctor density, and a soil that provides a given soil stiffness with the least compactive effort. Each higher-number soil-stiffness category provides successively less soil stiffness at a given percentage of maximum Proctor density and requires greater compactive effort to provide a given level of soil stiffness.

NOTE 3—See Practices D 2487 and D 2488 for laboratory and field visual-manual procedures for identification of soils.

NOTE 4—Processed materials produced for highway construction, including coarse aggregate, base, subbase, and surface coarse materials,

when used for foundation, embedment, and backfill, should be categorized in accordance with this section and Table 1 in accordance with particle size and gradation.

5.2 *Installation and Use*—Table 3 provides recommendations on installation and use based on soil-stiffness category and location in the trench. Categories SC1 to SC4 should be used as recommended in Table 3. Soil-stiffness Category 5, including clays and silts with liquid limits greater than 50, organic soils, and frozen soils, shall be excluded from the pipe-zone embedment.

5.2.1 *Soil-Stiffness Category 1 (SC1)*—SC1 materials provide maximum stability and pipe support for a given percent compaction due to the low content of sand and fines. With minimum effort these materials can be installed at relatively high-soil stiffnesses over a wide range of moisture contents. In addition, the high permeability of SC1 materials may aid in the control of water, and these materials are often desirable for embedment in rock cuts where water is frequently encountered. However, when ground-water flow is anticipated, consideration should be given to the potential for migration of fines from adjacent materials into the open-graded SC1 materials. (See 5.5.)

5.2.2 *Soil-Stiffness Category 2 (SC2)*—SC2 materials, when compacted, provide a relatively high level of pipe support; however, open-graded groups may allow migration and the sizes should be checked for compatibility with adjacent material; see 6.5.

5.2.3 *Soil-Stiffness Category 3 (SC3)*—SC3 materials provide less support for a given density than SC1 or SC2 materials. Higher levels of compactive effort are required and moisture content must be near optimum to minimize compactive effort and achieve the required density. These materials provide reasonable levels of pipe support once proper density is achieved.

5.2.4 *Soil-Stiffness Category 4 (SC4)*—SC4 materials require a geotechnical evaluation prior to use. Moisture content must be near optimum to minimize compactive effort and achieve the required density. Properly placed and compacted, SC4 materials can provide reasonable levels of pipe support; however, these materials may not be suitable under high fills, surface-applied wheel loads, or under high-energy-level vibratory compactors and tampers. Do not use where water conditions in the trench may prevent proper placement and compaction.

NOTE 5—The term “high energy level vibratory compactors and tampers” refers to compaction equipment that might deflect or distort the pipe more than permitted by the specifications or the manufacturer.

5.2.5 *Soil-Stiffness Category 5 (SC5)*—SC5 materials should be excluded from pipe-zone embedment.

5.3 *Moisture Content of Embedment Materials*—The moisture content of embedment materials must be controlled to permit placement and compaction to required levels. For non-free draining soils (that is, SC3 and SC4 and some borderline SC2 soils), moisture content is normally controlled to ± 3 % of optimum (see Test Method D 698). The practicality of obtaining and maintaining the required limits on moisture content is an important criterion for selecting materials, since

TABLE 1 Soil Classification Chart (see Classification D 2487)

Criteria for Assigning Group Symbols and Group Names Using Laboratory Tests ^A				Soil Classification	
				Group Symbol	Group Name ^B
Coarse-Grained Soils More than 50 % retained on No. 200 sieve	gravels more than 50 % of coarse fraction retained on No. 4 sieve	clean gravels less than 5 % fines ^E	$Cu \geq 4$ and $1 \leq Cc \leq 3^C$ $Cu < 4$ and/or $1 > Cc > 3^C$	GW	well-graded gravel ^D
				GP	poorly graded gravel ^D
	sands 50 % or more of coarse fraction passes No. 4 sieve	gravels with fines more than 12 % fines ^E	Fines classify as ML or MH	GM	silty gravel ^{D,F,G}
			Fines classify as CL or CH	GC	clayey gravel ^{D,F,G}
		clean sands	$Cu \geq 6$ and $1 \leq Cc \leq 3^C$	SW	well-graded sand ^H
		less than 5 % fines/ ^I	$Cu < 6$ and/or $1 > Cc > 3^C$	SP	poorly graded sand ^H
		sands with fines	Fines classify as ML or MH	SM	silty sand ^{F,G,H}
		more than 12 % fines/ ^I	Fines classify as CL or CH	SC	clayey sand ^{F,G,H}
Fine-Grained Soils 50 % or more passes the No. 200 sieve	silts and clays liquid limit less than 50	inorganic	$PI > 7$ and plots on or above "A" line ^J $PI < 4$ or plots below "A" line ^J	CL	lean clay ^{K,L,M}
				ML	silt ^{K,L,M}
	silts and clays liquid limit 50 or more	organic	liquid limit – oven dried liquid limit – not dried < 0.75	OL	organic clay ^{K,L,M,N} organic silt ^{K,L,M,O}
		inorganic	PI plots on or above "A" line PI plots below "A" line	CH	fat clay ^{K,L,M}
				MH	elastic silt ^{K,L,M}
		organic	liquid limit – oven dried liquid limit – not dried < 0.75	OH	organic clay ^{K,L,M,P} organic silt ^{K,L,M,Q}
Highly organic soils	primarily organic matter, dark in color, and organic odor			PT	peat

^A Based on the material passing the 3-in. (75-mm) sieve.

^B If field sample contained cobbles or boulders, or both, add "with cobbles or boulders, or both" to group name.

$$C_u = D_{60}/D_{10} \quad C_c = \frac{(D_{30})^2}{D_{10} \times D_{60}}$$

^D If soil contains ≥ 15 % sand, add "with sand" to group name.

^E Gravels with 5 to 12 % fines require dual symbols:

GW-GM well-graded gravel with silt
GW-GC well-graded gravel with clay
GP-GM poorly graded gravel with silt
GP-GC poorly graded gravel with clay

^F If fines classify as CL-ML, use dual symbol GC-GM, or SC-SM.

^G If fines are organic, add "with organic fines" to group name.

^H If soil contains ≥ 15 % gravel, add "with gravel" to group name.

^I Sands with 5 to 12 % fines require dual symbols:

SW-SM well-graded sand with silt
SW-SC well-graded sand with clay
SP-SM poorly graded sand with silt
SP-SC poorly graded sand with clay

^J If Atterberg limits plot in hatched area, soil is a CL-ML, silty clay (see Test Method D 4318).

^K If soil contains 15 to 29 % plus No. 200, add "with sand" or "with gravel," whichever is predominant.

^L If soil contains ≥ 30 % plus No. 200, predominantly sand, add "sandy" to group name.

^M If soil contains ≥ 30 % plus No. 200, predominantly gravel, add "gravelly" to group name.

^N $PI \geq 4$ and plots on or above "A" line.

^O $PI < 4$ or plots below "A" line.

^P PI plots on or above "A" line.

^Q PI plots below "A" line.

failure to achieve required density, especially in the pipe zone embedment, may result in excessive deflection.

5.4 Maximum Particle Size—Maximum particle size for pipe-zone embedment is limited based on pipe diameter as listed in Table 4. For final backfill, the maximum particle size allowed should not exceed 75 % of the lift thickness. When final backfill contains cobbles, boulders, etc., the initial bedding should be extended above the top of the pipe at least 12 in. (300 mm). Backfill containing particles larger than 8 in. (200 mm) shall not be dropped on the backfill or rolled down a sloping trench wall from a height greater than 6 ft (1.8 m) until the depth of fill over the top of the pipe is greater than 24 in. (600 mm).

NOTE 6—The limits of 200 mm (8 in.) particles and a drop height of 6 ft (1.8 m) are somewhat arbitrary, but serve to establish the principle that dropping boulders onto the backfill can damage the pipe even though

some backfill has already been placed on the pipe.

5.5 Migration—When open-graded material is placed adjacent to a finer material, fines may migrate into the coarser material under the action of hydraulic gradient from ground water flow. Significant hydraulic gradients may arise in the pipeline trench during construction, when water levels are being controlled by various pumping or well-pointing methods, or after construction, when permeable underdrain or embedment materials act as a "french" drain under high ground water levels. Field experience shows that migration can result in significant loss of pipe support and increasing deflections that may eventually exceed design limits. The gradation and relative size of the embedment and adjacent materials must be compatible in order to minimize migration. In general, where significant ground water is anticipated, avoid placing coarse, open-graded materials, such as SC1, above, below, or adjacent

TABLE 2 Soil-Stiffness Categories

NOTE 1—Soil stiffness categories group types together as a function of the relative level of soil stiffness developed when compacted to a given level. At any given level of compaction, SC1 soils provide the highest stiffness and SC5 soils the lowest.

NOTE 2—The soil-stiffness categories are similar but not identical to the soil classes in Practice D 2321.

Soil Group	Soil Stiffness Category
Crushed rock: 15 % sand, maximum 25 % passing the $\frac{3}{8}$ in. sieve and maximum 5 % passing a #200 sieve	SC1
Clean, coarse grained soils: SW, SP, GW, GP or any soil beginning with one of these symbols with 12 % or less passing a #200 sieve	SC2
Coarse grained soils with fines: GM, GC, SM, SC, or any soil beginning with one of these symbols, containing more than 12 % passing a #200 sieve;	SC3
Sandy or gravelly fine-grained soils: CL, ML, (or CL-ML, CL/ML, ML/CL) with more than 30 % retained on a #200 sieve	SC4
Fine-grained soils: CL, ML, (or CL-ML, CL/ML, ML/CL) with 30 % or less retained on a #200 sieve	
MH, CH, OL, OH, PT	SC5
	Not for use as embedment

to finer materials, unless methods are employed to impede migration such as the use of an appropriate soil filter or a geotextile filter fabric along the boundary of the incompatible materials.

5.5.1 The following filter gradation criteria may be used to restrict migration of fines into the voids of coarser material under a hydraulic gradient:

$$D_{15}/d_{85} < 5 \quad (1)$$

where:

D_{15} = sieve opening size passing 15 % by weight of the coarser material, and

d_{85} = sieve opening size passing 85 % by weight of the finer material.

$$D_{50}/d_{50} < 25 \quad (2)$$

where:

D_{50} = sieve opening size passing 50 % by weight of the coarser material, and

d_{50} = sieve opening size passing 50 % by weight of the finer material. This criterion need not apply if the coarser material is well-graded (see Classification D 2487).

5.5.2 If the finer material is a medium to highly plastic clay without sand particles (CL or CH), then the following criterion may be used instead of 6.5.1:

$$D_{15} < 0.02 \text{ in. (0.5 mm)} \quad (3)$$

where:

D_{15} = sieve-opening size passing 15 % by weight of the coarser material.

NOTE 7—Materials selected for use based on filter-gradation criteria

such as in 6.5 should be handled and placed in a manner that will minimize segregation.

5.6 *Cementitious Backfill Materials*—Backfill materials supplemented with cement to improve long-term strength and/or stiffness (soil cement, cement stabilized backfill) or to improve flowability (flowable fill, controlled low strength material) have been shown to be effective backfill materials in terms of ease of placement and quality of support to pipe. While not specifically addressed by this standard, use of these materials is beneficial under many circumstances.

6. Trench Excavation

6.1 *Excavation*—Excavate trenches to ensure that sides will be stable under all working conditions. Slope trench walls or provide supports in conformance with all local and national standards for safety. Place excavated material away from the edge of the trench. Open only enough trench that can be safely maintained by available equipment. Place and compact backfill in trenches as soon as practicable, preferably no later than the end of each working day.

6.2 *Water Control*—It is always good practice to remove water from a trench before laying and backfilling pipe. While circumstances occasionally require pipe installation in standing or running water conditions, such practice is outside the scope of this practice. At all times prevent run-off and surface water from entering the trench.

6.2.1 *Ground Water*—When ground water is present in the work area, dewater to maintain stability of in situ and imported materials. Maintain the water level below pipe bedding. Use, as appropriate, sump pumps, well points, deep wells, geotextiles, perforated underdrains or stone blankets of sufficient thickness to remove and control water in the trench. When excavating while lowering the ground water level, ensure that the ground water is below the bottom of cut at all times to prevent washout from behind sheeting or sloughing of exposed trench walls. Maintain control of water in the trench before, during, and after pipe installation, and until embedment is installed and sufficient backfill has been placed to prevent flotation of the pipe. To preclude loss of soil support, employ dewatering methods that minimize removal of fines and the creation of voids in in situ materials.

6.2.2 *Running Water*—Control running water emanating from surface drainage or ground water to preclude undermining of the trench bottom or walls, the foundation, or other zones of embedment. Provide dams, cutoffs, or other barriers periodically along the installation to preclude transport of water along the trench bottom. Backfill all trenches as soon as practical after the pipe is installed to prevent disturbance of pipe and embedment.

6.2.3 *Materials for Water Control*—Use suitably graded materials in the foundation as drainage blankets for transport of running water to sump pits or other drains. Use properly graded materials or perforated underdrains, or both, to enhance transport of running water. Select the gradation of the drainage materials to minimize migration of fines from surrounding materials. (See 5.5.)

6.3 *Minimum Trench Width*—Where trench walls are stable or supported, provide a width sufficient, but no greater than necessary, to ensure working room to properly and safely place

TABLE 3 Recommendations for Installation and Use of Soils and Aggregates for Foundation and Pipe-Zone Embedment

Soil Stiffness Category ^A	SC1	SC2	SC3	SC4
General Recommendations and Restrictions	Acceptable and common where no migration is probable or when combined with a geotextile filter media. Suitable for use as a drainage blanket and under drain where adjacent material is suitably graded or when used with a geotextile filter fabric (see 6.5).	Where hydraulic gradient exists check gradation to minimize migration. Clean groups are suitable for use as a drainage blanket and underdrain (see Table 2). Uniform fine sands (SP) with more than 50 % passing a #100 sieve (0.006 in., 0.15 mm) behave like silts and should be treated as SC3 soils.	Do not use where water conditions in trench prevent proper placement and compaction. Not recommended for use with pipes with stiffness of 9 psi or less	Difficult to achieve high-soil stiffness. Do not use where water conditions in trench prevent proper placement and compaction. Not recommended for use with pipes with stiffness of 9 psi or less
Foundation	Suitable as foundation and for replacing over-excavated and unstable trench bottom as restricted above.	Suitable as foundation and for replacing over-excavated and unstable trench bottom as restricted above. Install and compact in 12 in. (300 mm) maximum layers	Suitable for replacing over-excavated trench bottom as restricted above. Install and compact in 6 in. (150 mm) maximum layers	Not suitable.
Pipe Zone Embedment	Suitable as restricted above. Work material under pipe to provide uniform haunch support.	Suitable as restricted above. Work material under pipe to provide uniform haunch support.	Suitable as restricted above. Difficult to place and compact in the haunch zone.	Suitable as restricted above. Difficult to place and compact in the haunch zone.
<i>Embedment Compaction:</i>				
Min Recommended Density, SPD ^B	^C	85 %	90 %	95 %
Relative Compactive Effort Required to Achieve Minimum Density	low	moderate	high	very high
Compaction Methods	vibration or impact	vibration or impact	impact	impact
Required Moisture Control	none	none	maintain near optimum to minimize compactive effort	maintain near optimum to minimize compactive effort

^A SC5 materials are unsuitable as embedment. They may be used as final backfill as permitted by the engineer.

^B SPD is standard Proctor density as determined by Test Method D 698.

^C Minimum density typically achieved by dumped placement.

TABLE 4 Maximum Particle Size for Pipe Embedment

Nominal Diameter (D _i) Range, in. (mm)	Maximum Particle Size, in., (mm)
D _i = 18 (D _i = 450)	0.50, (13)
18 < D _i = 24 (450 < D _i = 600)	0.75 (19)
24 < D _i = 36 (600 < D _i = 900)	1.00 (25)
36 < D _i = 48 (900 < D _i = 1200)	1.25 (32)
48 < D _i (1200 < D _i)	1.50 (38)

and compact haunching and other embedment materials. The space between the pipe and trench wall must be wider than the compaction equipment used in this region. For a single pipe in a trench, the minimum trench width should be 1.25 times the outside diameter of the pipe plus 12 in. (300 mm). For multiple pipes in the same trench, interior spaces between pipes must be at least the average of the radii of the two adjacent pipe for depths greater than 12 ft (3.5 m), and $\frac{2}{3}$ of the average of the radii of the two adjacent pipe for depths less than 12 ft (3.5 m); the distance from the outside pipe to the trench wall must not be less than if that pipe were installed as a single pipe in a trench. If mechanical compaction equipment is used, the minimum space between pipe and trench wall, or between adjacent pipe shall not be less than the width of the widest piece of equipment plus 6 in. (150 mm). In addition to safety considerations, trench width in unsupported, unstable soils will depend on the size and stiffness of the pipe, stiffness of the embedment and in situ soil, and depth of cover. Specially designed equipment may facilitate the satisfactory installation and embedment of pipe in trenches narrower than specified above. If it is determined that the use of such equipment

provides an installation consistent with the requirements of this practice, minimum trench widths may be reduced if approved by the engineer.

6.4 Support of Trench Walls—When supports such as trench sheeting, trench jacks, trench shields, or boxes are used, ensure that support of the pipe and the embedment is maintained throughout the installation process. Ensure that sheeting is sufficiently tight to prevent washing out of the trench wall from behind the sheeting. Provide tight support of trench walls below viaducts, existing utilities, or other obstructions that restrict driving of sheeting.

6.4.1 Support Left in Place—Unless otherwise directed by the engineer, sheeting driven below the top of the pipe should be left in place to preclude loss of support of foundation and embedment materials. When the top of the sheeting is to be cut off, make the cut 1.5 ft (0.5 m) or more above the crown of the pipe. Leave rangers, walers, and bracers in place as required to support cutoff sheeting and the trench wall in the vicinity of the pipe. Timber sheeting to be left in place is considered a permanent structural member, and should be treated against biological degradation (for example, attack by insects or other biological forms), as necessary, and against decay if above ground water.

NOTE 8—Certain preservative and protective compounds may pose environmental hazards. Determination of acceptable compounds is outside the scope of this practice.

6.4.2 Movable Trench-Wall Supports—Do not disturb the installed pipe and its embedment when using movable trench boxes and shields. Movable supports should not be used below the top of the pipe embedment zone, unless approved methods

are used for maintaining the integrity of embedment material. Before moving supports, place and compact embedment to sufficient depths to ensure protection of the pipe. As supports are moved, finish placing and compacting embedment, and ensure the direct compaction of embedment materials against the undisturbed native soil.

6.4.3 Removal of Trench-Wall Support— If the engineer permits the use of sheeting or other trench-wall supports that extend below the top of the pipe, ensure that neither pipe, foundation, nor embedment materials is disturbed by support removal. Fill voids left on removal of supports and compact all material to required densities.

6.5 Trench-Bottom—Excavate trenches to a minimum depth of 4 in. (100 mm) below the pipe. See Section 7 for guidance on installing foundation and bedding.

6.5.1 When ledge, rock, hardpan or other unyielding material, cobbles, rubble or debris, boulders, or stones larger than 1.5 in. (38 mm) are encountered in the trench bottom, excavate a minimum depth of 6 in. (150 mm) below the pipe bottom, or as directed by the engineer.

6.5.2 If the trench bottom is unstable or shows a “quick” tendency, overexcavate to depths directed by the engineer.

6.6 Trenching on Slopes—The angle at which slopes can become unstable depends on the quality of the soil. The risk of unstable conditions increases dramatically with slope angle. In general, pipes should not be installed on slopes greater than 15 degrees (a slope of 1 to 4) or in areas where slope instability is suspected, unless supporting conditions have been verified by a proper geotechnical investigation. Installing pipes above ground may be a preferred method for steep slopes as above ground structures such as pipe supports are more easily defined and, therefore, the quality of installation is easier to monitor and settlement easier to detect. Pipes may be installed on slopes greater than 15 degrees (a slope of 1 to 4) provided that:

6.6.1 Long term stability of the installation can be ensured with proper geotechnical design.

6.6.2 Pipes are backfilled with coarse-grained material (SC1) with high shear strength or the shear strength of the backfill is assured by other means. The backfill should be compacted to at least 90 % of maximum standard Proctor density (Test Method D 698).

6.6.3 Pipes should be installed in straight alignment (plus or minus 0.2 degrees) with minimum gap between pipe ends.

6.6.4 Absolute long term movement of the backfill in the axial direction of the pipe must be less than 0.75 in. (20 mm) to avoid joint separation.

6.6.5 The installation is properly drained to avoid washout of materials and ensure adequate soil shear strength.

6.6.6 Stability of individual pipes is monitored throughout the construction phase and the first stages of operation.

6.6.7 The manufacturer is consulted to determine if a special pipe design is required.

7. Installation

7.1 General—Recommendations for use of the various types of materials classified in Section 5 and Table 1 for the foundation and pipe zone embedment are given in Table 3.

NOTE 9—Installation of pipe in areas where significant settlement may be anticipated, such as in backfill adjacent to building foundations, and in sanitary landfills, or in other highly unstable soils, require special engineering and are outside the scope of this practice.

7.2 Foundation/Bedding—Install foundation and bedding as required by the engineer in accordance with conditions in the trench-bottom. Provide a firm, stable, and uniform bedding for the pipe barrel and any protruding features of its joint. Provide a minimum of 4 in. (100 mm) of bedding below the barrel and 3 in. (75 mm) below any other part of the pipe unless otherwise specified.

7.2.1 Bedding Material—Often the bedding material will need to be an imported material to provide the proper gradation and pipe support. The bedding material should be the same material as the initial backfill. Native-soil material can be used as a bedding material if it meets the requirements of the initial backfill. This determination must be made as the pipe installation progresses because native-soil conditions vary widely and may change suddenly along the length of a pipeline. It is increasingly common to leave the bedding uncompacted for a width of $\frac{1}{3}$ of the pipe diameter centered directly under the pipe. This reduces concentrated loads on the invert of the pipe.

7.2.2 Rock and Unyielding Materials— When rock or unyielding material is present in the trench bottom, install a cushion of bedding, 6-in. (150-mm) minimum thickness, below the bottom of the pipe.

7.2.3 Unstable Trench-Bottom—Where the trench-bottom is overexcavated because of unstable or “quick” conditions, install a foundation of SC1, SC2, or larger materials. Complete the foundation with a suitably graded material where conditions may cause migration of fines and loss of pipe support. For severe conditions, the engineer may require a special foundation such as piles or sheeting capped with a concrete mat. Control of quick and unstable trench-bottom conditions may be accomplished with the use of geotextiles.

7.2.4 Localized Loadings—Minimize localized loadings and differential settlement wherever the pipe crosses other utilities or subsurface structures, or whenever there are special foundations such as concrete-capped piles or sheeting. Provide a 6-in. (150-mm) minimum cushion of bedding between the pipe and any such point of localized loading.

7.2.5 Over-Excavation—If the trench bottom is over-excavated below intended grade, fill the over-excavation with compatible foundation or bedding material and compact to a density not less than the minimum densities stated in Table 3.

7.2.6 Sloughing—If trench sidewalls slough off during any excavation or installation of pipe-zone embedment, remove all sloughed and loose material from the trench.

7.3 Location and Alignment—Place pipe and fittings in the trench with the invert conforming to the required elevations, slopes, and alignment. Provide bell holes in pipe bedding, no larger than necessary, in order to ensure uniform pipe support. Fill all voids under the bell by working in bedding material. In special cases where the pipe is to be installed to a curved alignment, maintain angular “joint deflection” (axial alignment) or pipe-bending radius within acceptable design limits, or both. Pipe should be laid on flat uniform material that is at the appropriate grade. Do not bring pipe to grade by the use of mounds of soil or other material at points along the length of

the pipe. When pipe laying is interrupted, secure piping against movement and seal open ends to prevent the entrance of water, mud, or foreign material.

7.4 Jointing—Comply with manufacturer’s recommendations for assembly of joint components, lubrication, and making of joints.

7.4.1 Elastomeric Seal Joints—Mark, or verify that pipe ends are marked, to indicate insertion stop position, and that pipe is inserted into pipe or fitting bells to this mark. Push spigot into bell using methods recommended by the manufacturer, keeping pipe true to line and grade. Protect the end of the pipe during assembly and do not use excessive force that may result in over-assembled joints or dislodged gaskets. If full entry is not achieved, disassemble and clean joint and reassemble. Use only lubricant supplied or recommended for use by the manufacturer. Do not exceed the manufacturer’s recommendations for angular “deflection” (axial alignment).

7.4.2 Adhesive-Bonded or Wrapped Joints, or Both—When making adhesive-bonded or wrapped joints, or both, follow recommendations of the pipe manufacturer. Allow freshly made joints to set for the recommended time before moving, burying, or otherwise disturbing the pipe.

NOTE 10—Axial restraint of the joined sections may be required during curing to prevent thermal expansion or contraction which could cause damage to the joint.

7.4.3 Angularly Deflected Joints—Large radius bends in pipelines may be accomplished by rotating the alignment of adjacent lengths of pipe (that is, “angularly deflecting” the joint). The amount of angular deflection should not exceed the manufacturer’s recommendations.

7.5 Placing and Compacting Backfill Materials—Place embedment materials by methods which will not disturb or damage the pipe. Work in and compact the haunching material in the area between the bedding and the underside of the pipe before placing and compacting the remainder of the pipe-zone embedment. Follow recommendations for compaction given in Table 3 and this section. Do not permit compaction equipment to contact and damage the pipe. Use compaction equipment and techniques that are compatible with materials used and location in the trench. See 8.6 for requirements for minimum cover.

7.5.1 Minimum Density—The minimum embedment density should be established by the engineer based on an evaluation of specific project conditions. Table 3 gives recommendation for minimum densities that are applicable to most typical projects. Higher densities than those recommended in Table 3 may be appropriate and occasionally lower densities than those recommended in Table 3 may be acceptable.

NOTE 11—The traditional measure of soil stiffness has been the modulus of soil reaction, E' , that is commonly used to predict flexible pipe deflection. Recently AASHTO has changed this parameter to the constrained soil modulus, M_s . See Appendix X2 for additional details.

7.5.2 Densification with Water—Densification of cohesionless material with water (jetting or saturation with vibration) should only be used under controlled conditions when approved by the engineer. Achieving a suitable water content in the soil is crucial and is best determined by trial test areas. Trial

test areas may also be useful in determining the size of internal vibrators required and the appropriate spacing of their insertion into the soil.

7.5.3 Compaction of Soils Containing Few Fines (Soil Stiffness Categories SC1 and SC2 with Less Than 5 % Fines)—If compaction is required, use surface plate vibrators, vibratory rollers, or internal vibrators. The compacted lift thickness should not exceed 12 in. (300 mm) when compacted with surface plate vibrators or vibratory rollers and should not exceed the length of the internal vibrator. Density determination should normally be in accordance with Test Methods D 4253 and D 4254 (relative density). In some cases, the density of SW or SP soils may be determined by Test Method D 698 (standard proctor) if the test results in a clearly defined compaction curve.

7.5.4 Compaction of Soils Containing Some Fines (Soil Stiffness Category SC2 with 5 to 12 % Fines)—These soils may behave as a soil containing few fines (see 7.5.3) or as a soil containing a significant amount of fines (see 7.5.5). The methods of compaction and density determination should be those methods (7.5.3 or 7.5.5) that result in the higher in-place density.

7.5.5 Compaction of Soils Containing a Significant Amount of Fines (Soil Stiffness Categories SC3, SC4, and SC5 (CH and MH))—These soils should be compacted with impact tampers or with sheepsfoot rollers. Density determination should be in accordance with Test Method D 698 (standard Proctor). The maximum density occurs at the optimum moisture content. Less effort is required to reach a given density when the moisture content is within two percentage points of the optimum moisture. A rapid method of determining the percent compaction and moisture variation is described in Test Method D 5080. For compaction levels of 90 % standard Proctor and higher, the compacted lift thickness should not exceed 6 in. (150 mm).

7.5.6 Determination of the In-Place Density of Soils—The in-place density of any in situ or fill soil may be determined in accordance with Test Method D 1556, D 2167, D 2922, D 4564, D 4914, or D 5030. The applicable test method will depend on the type of soil, moisture content of the soil, and the maximum particle size present in the soil. The moisture content of the soil may be determined in accordance with Test Method D 2216, D 3017, D 4643, D 4944, or D 4959. When using nuclear density-moisture gages (Test Methods D 2922 and D 3017), the gage should be site-calibrated in the proximity of the pipe and in the excavation unless otherwise indicated by the gage manufacturer.

7.6 Backfill Around Angularly Deflected Pipe Joints—When pipe joints are angularly rotated to accomplish large radii bends in pipelines that will operate at internal pressures of 15 psig (100 kPa) or greater, the backfill surrounding the joint should be compacted to at least 90 % of maximum standard Proctor density (or appropriate alternate standard for soils with few fines) for SC1 and SC2 materials, and 95 % of maximum standard Proctor density for SC3 and SC4 materials. Consult the manufacturer for minimum depths of burial and additional restraint that may be required when the angular deflection is vertical.

7.7 Minimum Cover—To preclude damage to the pipe and disturbance to pipe embedment, a minimum depth of backfill above the pipe should be maintained before allowing vehicles or heavy construction equipment to traverse the pipe trench. The minimum depth of cover for surface loads, should be established by the engineer based on an evaluation of specific project conditions, including the pipe-zone embedment material and density, the native-soil characteristics, pipe stiffness, pipe diameter, surface pavement, surface loads, and final backfill compaction. In the absence of an engineering evaluation, the following minimum cover requirements should be used.

7.7.1 For embedment materials installed to the minimum densities given in Table 3, provide cover (that is, depth of backfill above top of pipe) of at least 24 in. (0.6 m) for SC1 embedment and a cover of at least 36 in. (0.9 m) for SC2, SC3, or SC4 embedment, before allowing vehicles or construction equipment to traffic the trench surface. Provide at least 48 in. (1.2 m) of cover before using a hydrohammer for compaction unless approved by the engineer. Where construction loads may be excessive (for example, cranes, earth-moving equipment, or other vehicles where wheel loads exceed the AASHTO HS-20 loading) minimum cover shall be increased as determined by the engineer. A minimum of one pipe diameter of cover is suggested to prevent flotation of an empty pipe when full soil saturation to the surface exists.

7.8 Connections and Appurtenant Structures:

7.8.1 Connections to Manholes and Rigid Structures—When differential settlement can be expected, such as at the ends of casing pipe, when the pipe enters a manhole or at anchor block, provide a flexible system capable of accommodating the anticipated settlement. This may be accomplished by placing a joint as close as practically possible to the face of the structure and a second joint within one to two pipe diameters from the face of the structure. The short length of pipe, called a rocker pipe shall be installed in a straight alignment with the short pipe section coming out of the rigid structure. Multiple rocker pipes should not be used. Alternatively, attach the pipe to the rigid structure with a flexible boot capable of accommodating the anticipated differential movement. Extra care and caution must be taken to replace and properly compact backfill adjacent to any rigid structure. Construction of concrete structures will frequently require over-excavation for formwork, etc. This extra-excavated material must be restored to a density level compatible with surroundings to prevent excess deformation and or joint rotation adjacent the structure. In these areas, compact backfill to achieve the same soil density as specified for all pipe backfill, but not less than that required to achieve a soil constrained modulus (M_a) of at least 1000 psi (6.9 MPa). Other methods of accommodating the differential settlements may be acceptable if approved in advance.

NOTE 12—The use of cement stabilized or flowable backfills adjacent to large structures has been found to be effective in preventing excess deformation where diameters are larger than about 60 in. (1,500 mm).

7.8.2 Vertical Risers—Provide support for vertical risers as commonly found at service connections, cleanouts, and drop manholes to preclude vertical or lateral movement. Prevent the

direct transfer of thrust due to surface loads and settlement, and ensure adequate support at points of connection to main lines.

7.9 Exposing Pipe for Making Service-Line Connections—When excavating for a service-line connection, excavate material from above the top of the existing pipe before removing material from the sides of the pipe. Materials and density of service-line embedment should conform to the specifications for the existing line, or with this practice, whichever is more stringent.

7.10 Pipe Caps and Plugs—Secure caps and plugs to the pipe to prevent movement and resulting leakage under test and service pressures.

7.11 Parallel Piping Systems—Compact the soil between the pipes in the same manner as the soil between the pipe and the trench wall, taking special care to compact the soil in the haunch zone.

8. Monitoring, Inspecting, and Testing

8.1 Field Monitoring—Compliance with pipe installation requirements, including trench depth, grade, water conditions, foundation, embedment and backfill materials, joints, density of materials in place, and safety should be monitored to assure conformance with accordance with contract documents.

8.2 Deflection—Monitor the deflection level in the pipe throughout the installation process for conformance to the requirements of the contract specifications and the manufacturer's recommendations. Conduct deflection measurements early in a project to verify that construction procedures are adequate. The deflection at the time of installation will be less than the long-term deflection due to time-dependent load increase. If necessary, also consider the effects of vertical ovaling during compaction. Deflection testing should be completed prior to undertaking pressure tests.

8.3 Pressure Testing—Most pressure pipelines are tested after installation to detect leaks, installation flaws, damaged pipes or other deficiencies (see Appendix X1). As a general rule, such tests should not be conducted using air pressure, unless special precautions, not within the scope of this practice, are used. Additional recommendations for conducting pressure tests include:

8.3.1 Required thrust restraints are properly installed (and sufficiently cured if applicable).

8.3.2 Backfilling should be completed. Some sections of the line may be left uncovered provided suitable lateral and longitudinal restraint is provided.

8.3.3 Pumps and valves are anchored.

8.3.4 Assure test caps and endplugs are properly installed and restrained as necessary.

8.3.5 Vent the pipeline while filling to allow all air to escape.

8.3.6 Pressurize the line slowly to avoid pressure surges.

8.3.7 In determining the test pressure remember that the lowest point on the line will have the highest pressure. If the test pressure gage is not installed at this location, then the pressure should be determined by calculation.

8.3.8 Assure that the test fluid temperature is stable during the test period (to avoid pressure changes due to thermal expansion or contraction that may be misinterpreted as leaks).

9. Inspection, Handling, and Storage

9.1 *Inspection*—Upon receipt, inspect each shipment of pipe and fittings for conformance to product specifications and contract documents, and check for damage. Reject or repair nonconforming or damaged pipe. Remove rejected pipe from the jobsite.

9.2 *Handling and Storage*—Proper handling and storage of the pipe is important to achieve a successful installation. Consult the manufacturer for recommendations and appropriate procedures.

10. Keywords

10.1 backfill; bedding; fiberglass pipe; haunching; soil stiffness; underground installation

APPENDIXES

(Nonmandatory Information)

X1. RECOMMENDATION FOR INCORPORATION IN CONTRACT DOCUMENTS

This practice may be incorporated by referral in contract documents for a specific project, to cover requirements for installation. Applications to a particular project should be made by means of a list of supplemental requirements. Suggested modifications to specific section numbers are listed as follows. (The list is keyed to applicable section numbers of the practice):

X1.1 *Paragraph 5.4*—Maximum particle size if different from this section.

X1.2 *Sections 5 and 7 and Table 3*—Further restrictions on use of categories of embedment and backfill materials.

X1.3 *Paragraph 5.5*—Specific gradations of embedment materials for resistance to migration.

X1.4 *Paragraph 6.1.1*—State specific restrictions on leaving trenches open.

X1.5 *Paragraph 6.2*—Restrictions on mode of dewatering; design of underdrains.

X1.6 *Paragraph 6.3*—Requirements on minimum trench width.

X1.7 *Paragraph 6.4*—Restrictions or details for support of trench walls.

X1.8 *Paragraph 7.5*—Specific restrictions on methods of compaction.

X1.9 *Paragraph 7.5.1 and Table 3*—Minimum embedment density if different from these recommendations; specific density requirements for backfill (for example, for pavement subgrade).

X1.10 *Paragraph 7.6*—Minimum cover requirements if different from this paragraph.

X1.11 *Paragraph 7.7.1*—Detailed requirements for man-hole connections.

X1.12 *Paragraph 7.7.2*—Detailed requirements for support of vertical risers, standpipes, and stacks to accommodate anticipated relative movements between pipe and such appurtenances. Detailing to accommodate thermal movements, particularly at risers.

X1.13 *Paragraph 8.11*—Requirements on methods of testing compaction and leakage.

X1.14 *Paragraph 8.12*—Requirements on deflection and deflection measurements, including method and time of testing.

X2. SOIL STIFFNESS

X2.1 In 2000, AASHTO adopted new values for soil stiffness for backfill materials used for thermoplastic pipe. The modifications include changing the soil design parameter from the modulus of soil reaction, E' , to the constrained soil modulus, M_s . This change is based on the work of McGrath (1998).⁹ Design values of the constrained modulus are pre-

sented in Table X2.1. The table shows that M_s increases with depth of fill which reflects the increased confining pressure. This is a well-known soil behavior. At moderate depths of fill the values of M_s are close to the E' values proposed by Howard (1977, 1996).^{10,11} In design for deflection control, M_s may be

⁹ McGrath, T. J., "Replacing E' with the Constrained Modulus in Flexible Pipe Design," *Proceedings of the Conference Pipelines in the Constructed Environment*, ASCE, 1998.

¹⁰ Howard, A. K., "Modulus of Soil Reaction Values for Buried Flexible Pipe," *Journal of Geotechnical Engineering*, ASCE, Vol 103, No. GT1, New York, NY, 1977.

¹¹ Howard, A. K., *Pipeline Installation*, Relativity Publishing, Lakewood, CO, 1996.

TABLE X2.1 Constrained Soil Modulus, M_s Based on Soil Type and Compaction Condition, Stiffness Category and Vertical Stress^{A,B,C}

Vertical Stress Level ^D (psi)	SC2-100 (psi)	SC2-95 (psi)	SC2-90 (psi)	SC2-85 (psi)
1	2,350	2,000	1,275	0,470
5	3,450	2,600	1,500	0,520
10	4,200	3,000	1,625	0,570
20	5,500	3,450	1,800	0,650
40	7,500	4,250	2,100	0,825
60	9,300	5,000	2,500	1,000

Vertical Stress Level ^D (psi)	SC3-95 (psi)	SC3-90 (psi)	SC3-85 (psi)
1	1,415	670	360
5	1,670	740	390
10	1,770	750	400
20	1,880	790	430
40	2,090	900	510
60	2,380	1,120	700

Vertical Stress Level ^D (psi)	SC4-95 (psi)	SC4-90 (psi)	SC4-85 (psi)
1	530	255	130
5	625	320	175
10	690	355	200
20	740	395	230
40	815	460	285
60	895	525	345

^A The soil types are defined by a stiffness category (SC) to indicate the general soil classification (See AWWA Manual M45). Specific soil groups that fall into these categories, based on Classification D 2487 and AASHTO M 145, are listed in Table X2.2.

^B The numerical suffix to the soil type indicates the compaction level of the soil as a percentage of maximum dry density determined in accordance with Test Method D 698 or AASHTO T-99.

^C For design, dumped SC1 soils may use the modulus values of SC2-90 and compacted SC1 soils may use the values of SC2-100.

^D Vertical stress level is the vertical effective soil stress at the springline elevation of the pipe. It is normally computed as the design soil density times the depth of fill to the springline. Buoyant soil density should be used below the groundwater level.

substituted directly for E' in the Iowa formula. Use of the constrained modulus in predicting deflection may be completed by making a direct substitution of M_s for E' in the Iowa formula. The Iowa formula is presented in many publications, in particular, AWWA Manual M45, Fiberglass Pipe Design.

X2.2 Example: Determine the constrained soil modulus at a depth of 10 ft for an SW soil with a unit weight of 120 pcf.

X2.2.1 Determine vertical applied stress:

$$p = 10 \text{ ft (120 pcf)} = 1200 \text{ psf} = 8.3 \text{ psi.}$$

X2.2.2 Determine constrained soil modulus for SW soil, which is soil type SC2-100 from Table X2.1, note c:

$$\text{for } p = 5 \text{ psi, } M_s = 3,450 \text{ psi;}$$

$$\text{for } p = 10 \text{ psi, } M_s = 4,200 \text{ psi.}$$

X2.2.3 Interpolating for $p = 8.3 \text{ psi}$, $M_s = 3450 + (4200 - 3450) \{(8.3 - 5)/(10 - 5)\} = 3945 \text{ psi.}$

TABLE X2.2 Equivalent AWWA, ASTM, and AASHTO Soil Classifications

Soil Type ^A	ASTM D 2487	AASHTO M 145
SC1 ^B	Crushed rock: 15 % sand, maximum 25 % passing the $\frac{3}{8}$ in. sieve and maximum 5 % passing No. 200 sieve	
SC2 ^C (Gravelly sand, SW)	Clean, coarse grained soils: SW, SP, GW, GP or any soil beginning with one of these symbols, with 12 % or less passing No. 200 sieve	A1, A3
SC3 ^C (Sandy silt, ML)	Coarse grained soils with fines: GM, GC, SM, SC, or any soil beginning with one of these symbols, containing 12 % or more passing No. 200 sieve; Sandy or gravelly fine-grained soils: CL, ML, (or CL-ML, CL/ML, ML/CL) with 30 % or more retained on a #200 sieve	A-2-4, A-2-5, A-2-6; or A-4 or A-6 soils with 30 % or more retained on a No. 200 sieve
SC4 ^C (Silty clay, CL)	Fine-grained soils: CL, ML, (or CL-ML, CL/ML, ML/CL) with 30 % or less retained on a #200 sieve	A-2-7; or A-4 or A-6 soils with 30 % or less retained on a No. 200 sieve

^A The soil classification listed in parentheses is the type that was tested to develop the constrained soil modulus values in Table X2.1. The correlations to other soil types are approximate.

^B SC1 soils include crushed rock and gravels with limited sand content. For design, dumped SC1 soils may use the modulus values of SC2-90 and compacted SC1 soils may use the modulus values of SC2-100.

^C Uniform fine sands (SP) with more than 50 % passing a No. 100 sieve (0.006 in., 0.15 mm) shall not be used as backfill for fiberglass pipe unless specifically allowed in the contract documents and special precautions are taken to control moisture content and monitor compaction levels.

NOTE—Soil type SC5, including MH, CH, and organic soils are not recommended for use as pipe backfill under any conditions.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).